


教学楼消防维修更换材料表					
序号	名称	型号规格	单位	数量	
1	25LGR3-10XS系列稳压装置	稳压罐规格: Φ800x2230, 配用水泵: Q=1.0L/S, H=60m; N=1.5KW	套	1.0	
2	流量开关	DN100	个	2.0	
3	屋顶稳压装置配电箱	ZYSB Pc-1.5kW	台	1.0	
4	蝶阀	DN100	个	4.0	
5	止回阀	DN100	个	4.0	
6	液压控制阀	DN80	个	4.0	
7	浮球阀	DN100	个	1.0	

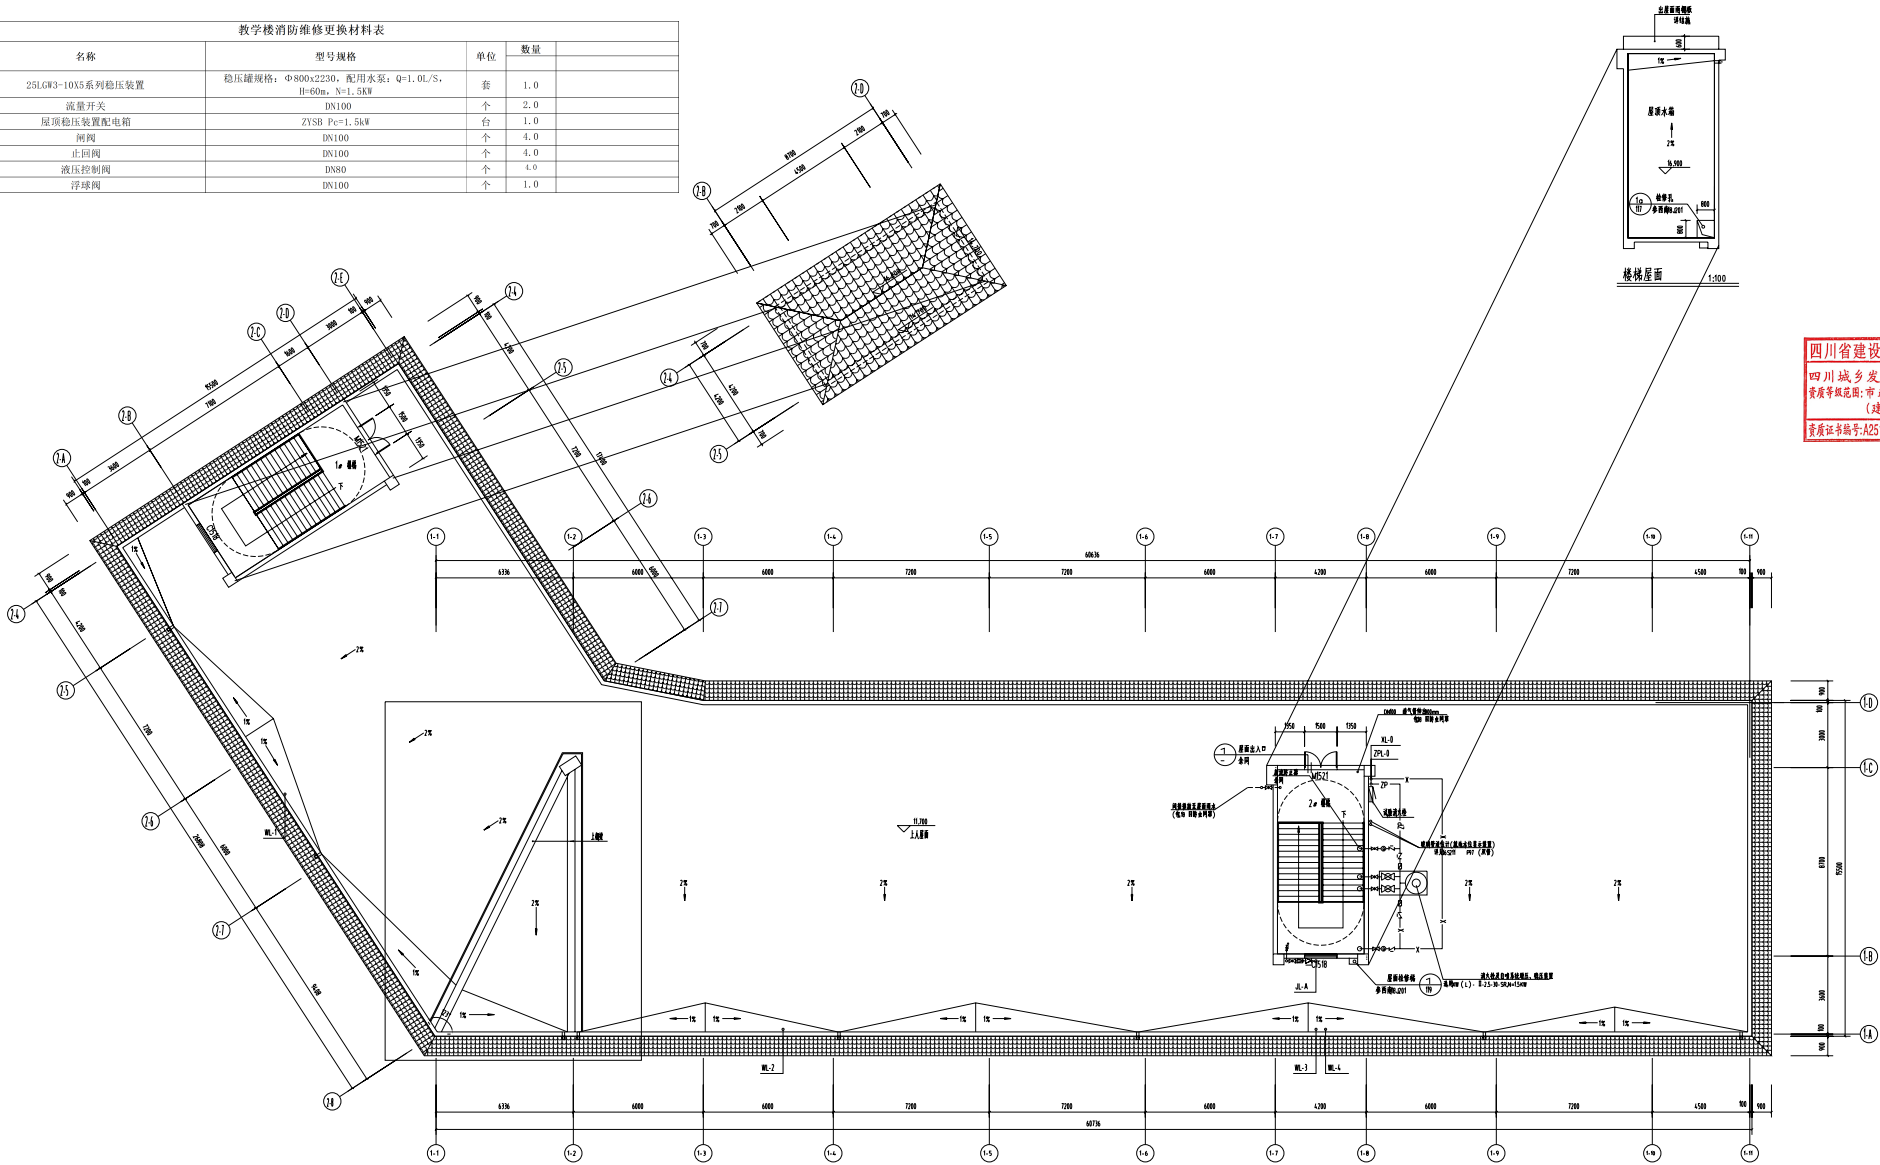

四川省建设工程设计
四川城乡发展工程设计有限公司
资质等级范围: 市政行业乙级; 建筑行业
(建筑工程) 专业乙级
资质证书编号: A251024425 有效期至: 2030年01月03日

审核人: (SEAL OF CERTIFICATION)

审核人: (SEAL OF CERTIFIED DESIGNER)

审核人: (SEAL OF DRAWING ISSUE)

审核人: (SEAL OF DRAWING APPROVAL)

审核人: (SEAL OF DRAWING)

审核人: (CLIENT)

审核人: (CLIENT)

审核人: (CLIENT)

审核人: (CLIENT)

审核人: (CLIENT)

审核人: (CLIENT)

审核人: (CLIENT)

审核人: (CLIENT)

审核人: (CLIENT)

审核人: (CLIENT)

审核人: (CLIENT)

审核人: (CLIENT)

审核人: (CLIENT)

审核人: (CLIENT)

审核人: (CLIENT)

审核人: (CLIENT)

审核人: (CLIENT)

审核人: (CLIENT)

审核人: (CLIENT)

审核人: (CLIENT)

审核人: (CLIENT)

审核人: (CLIENT)

审核人: (CLIENT)

审核人: (CLIENT)

审核人: (CLIENT)

审核人: (CLIENT)

审核人: (CLIENT)

审核人: (CLIENT)

审核人: (CLIENT)

审核人: (CLIENT)

审核人: (CLIENT)

审核人: (CLIENT)

审核人: (CLIENT)

审核人: (CLIENT)


审核人: (CLIENT)

审核人: (CLIENT)

审核人: (CLIENT)

审核人: (CLIENT)

审核人: (CLIENT)

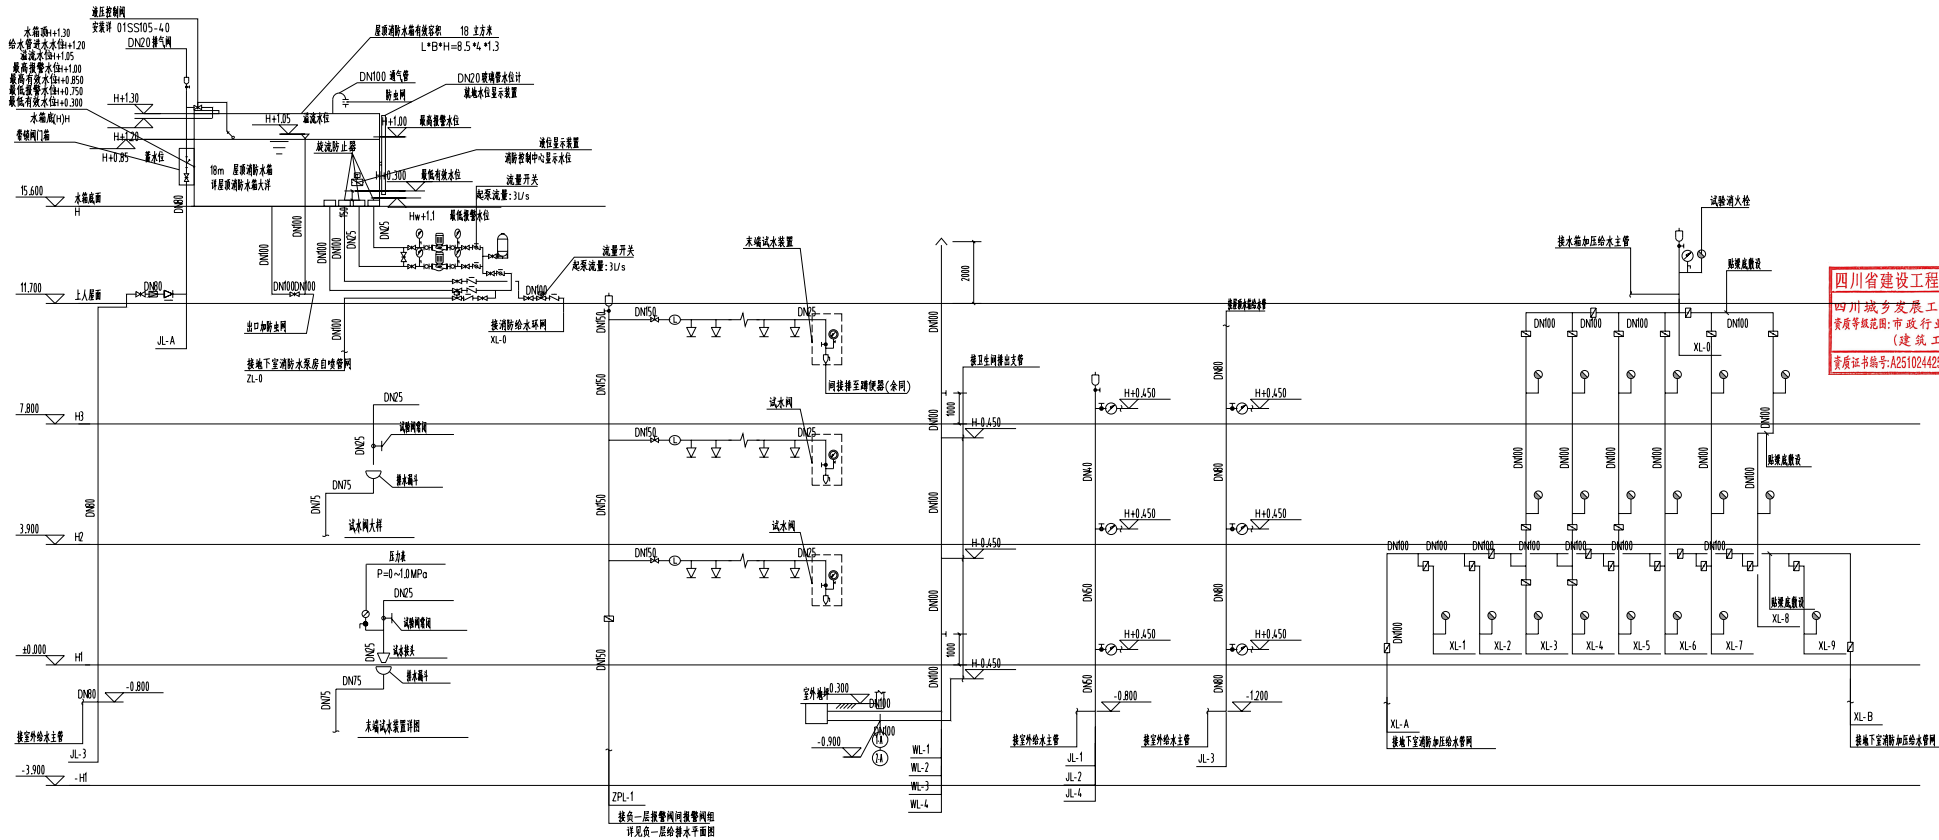

给排水系统原理图

注:水箱出水管由楼梯顶部标高上穿出

四川省建设工程设计图专用章
四川城步发展工程设计有限公司
资质等级范围:市政行业乙级;建筑行业
(建筑工程)专业乙级
资质证书编号:A251024425 有效期至:2030年01月03日

审核人: (SEAL OF CERTIFICATION)

审核人: (SEAL OF CERTIFIED DESIGNER)

审核人: (SEAL OF DRAWING ISSUE)

审核人: (SEAL OF DRAWING APPROVAL)

审核人: (SEAL OF KEY PLAN)

审核人: (CLIENT)

审核人: (CLIENT)

审核人: (CLIENT)

审核人: (CLIENT)

审核人: (CLIENT)

审核人: (CLIENT)

审核人: (CLIENT)

审核人: (CLIENT)

审核人: (CLIENT)

审核人: (CLIENT)

审核人: (CLIENT)

审核人: (CLIENT)

审核人: (CLIENT)

审核人: (CLIENT)

审核人: (CLIENT)

审核人: (CLIENT)

审核人: (CLIENT)

审核人: (CLIENT)

审核人: (CLIENT)

审核人: (CLIENT)

审核人: (CLIENT)

审核人: (CLIENT)

审核人: (CLIENT)

审核人: (CLIENT)

审核人: (CLIENT)

审核人: (CLIENT)

审核人: (CLIENT)

审核人: (CLIENT)

审核人: (CLIENT)

审核人: (CLIENT)

审核人: (CLIENT)

审核人: (CLIENT)

审核人: (CLIENT)

审核人: (CLIENT)

审核人: (CLIENT)

审核人: (CLIENT)

审核人: (CLIENT)

审核人: (CLIENT)

审核人: (CLIENT)

